



TEMPORARY SLOPE DRAIN

City of Angola - Engineering Department

Created: July 16, 2021

Updated: November 4, 2024

Scale: NTS

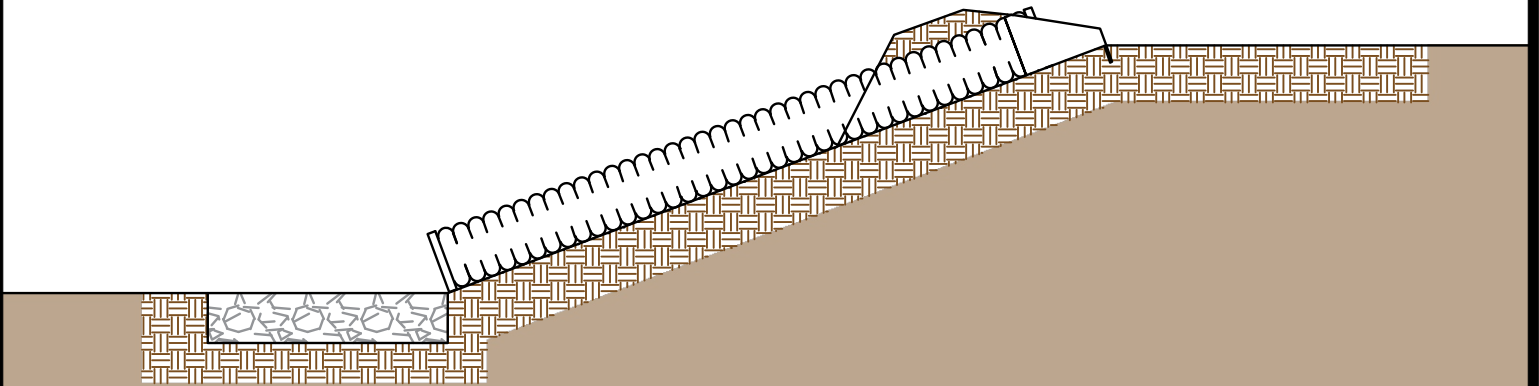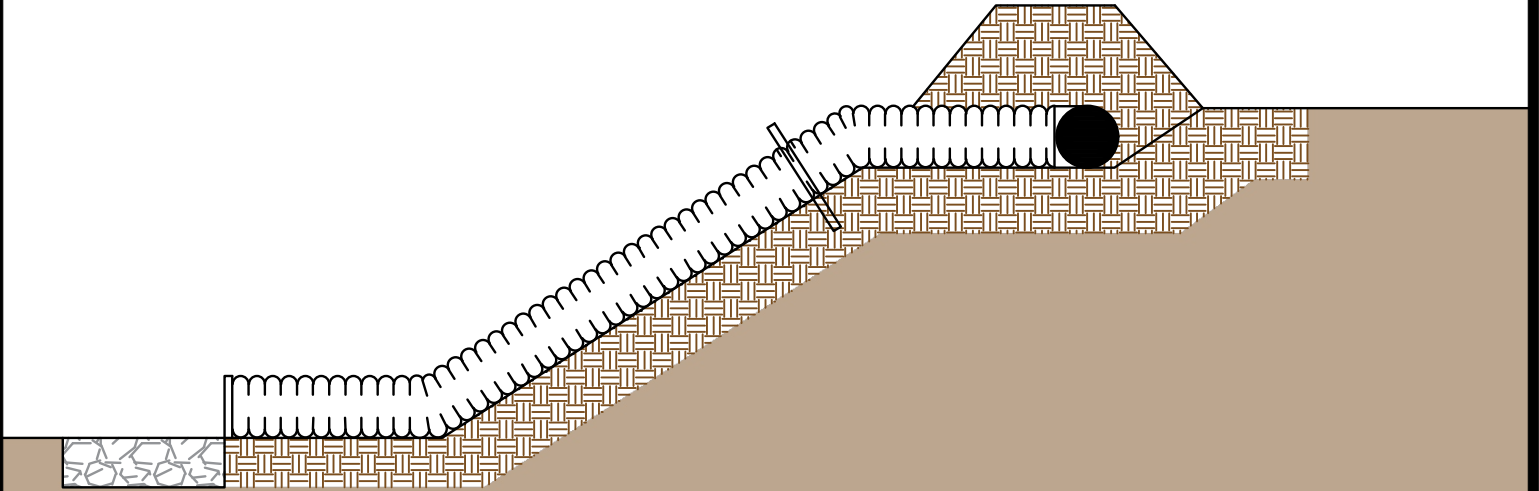

Notes:

1. See Table 1 above for pipe sizing.
2. Pipe to be a strong and flexible material such as heavy-duty, non-perforated, corrugated plastic.
3. Inlets to have a "T" or flared end section.
4. Wooden stakes or rebar to be used as bracing at max 10ft spacing.
5. Install sediment trap at pipe outlet to capture sediment laden discharge.
6. Please reference the Indiana Storm Water Quality Manual for additional specifications.