

INLET PROTECTION - SILT FENCE


City of Angola - Engineering Department

Created: July 16, 2021


Updated: November 4, 2024

Scale: NTS

Plan View

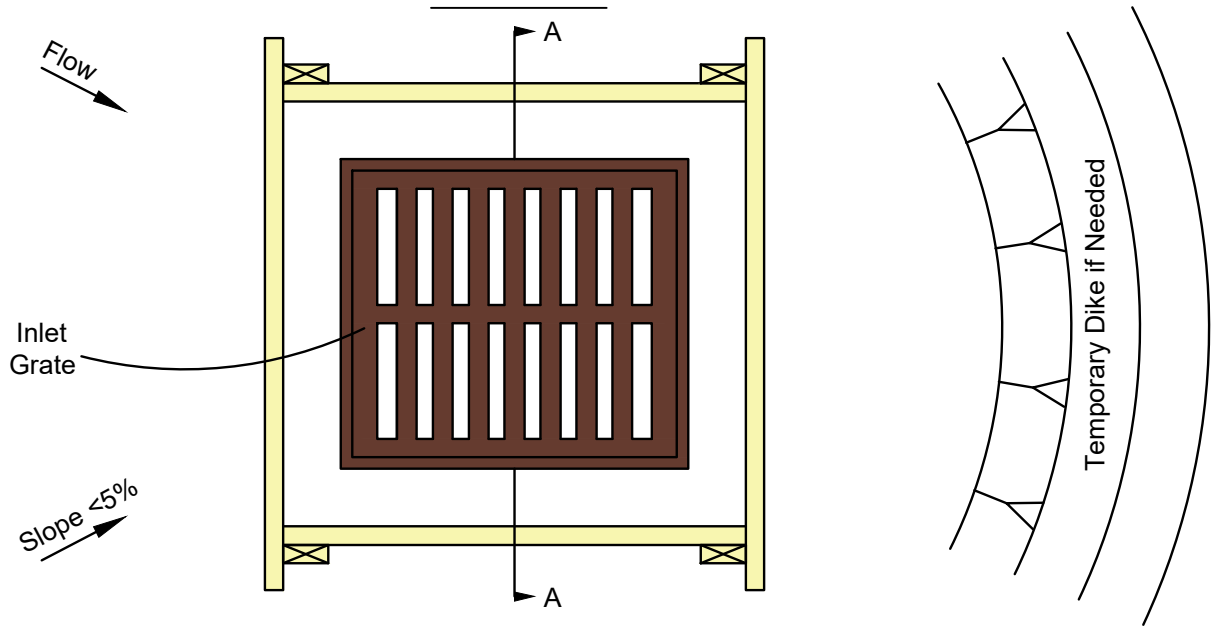

Section A-A

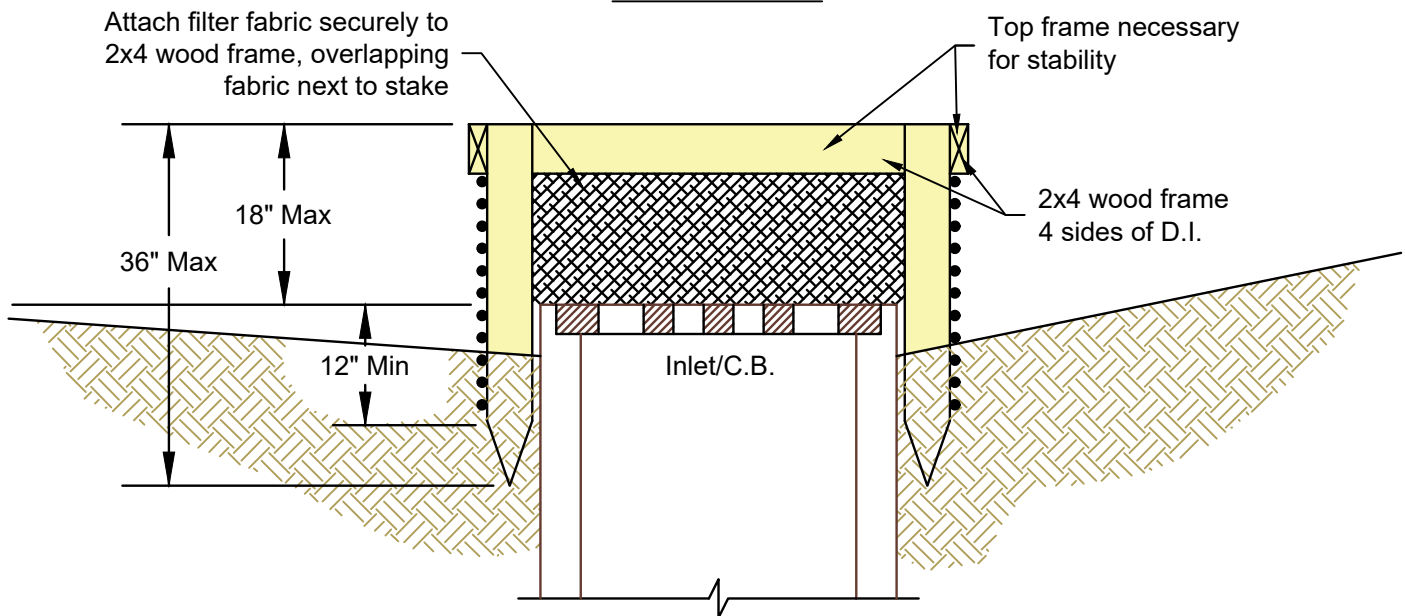

Notes:

- Drop inlet sediment barriers are to be used for small, nearly level drainage areas. (less than 5% slope)
- Use 2x4 wood or equivalent metal stakes, (3ft minimum length)
- Install 2x4 wood top frame to insure stability.
- The top of the frame (ponding height) must be well below the ground elevation downslope to prevent runoff from bypassing the inlet. A temporary dike may be necessary on the downslope side of the structure.
- Please reference the Indiana Storm Water Quality Manual for additional specifications.